

Honeywell
12 Clintonville Road
Northford, CT 06472-1610
<http://www.honeywellpower.com>

FireForce 8 Module
Notification Appliance Circuit Expander
PN 52256:B1 04/28/2008 ECN 08-303

Product Installation Document

1. Secure FireForce 8 (PC board assembly P/N 31053) with four (4) #6-32 x 0.25 inch screws. Be sure to tighten screws to ensure proper ground connection.
2. Secure power supply (PC board assembly P/N 31057) with four (4) #6-32 x 0.25 inch screws. Be sure to tighten screws to ensure proper ground connection.
3. Plug in 3 connector cable to power supply at position J1.
4. For complete assembly and wiring instructions, refer to the *FireForce 8 Installation & Operation Manual P/N 52257*.

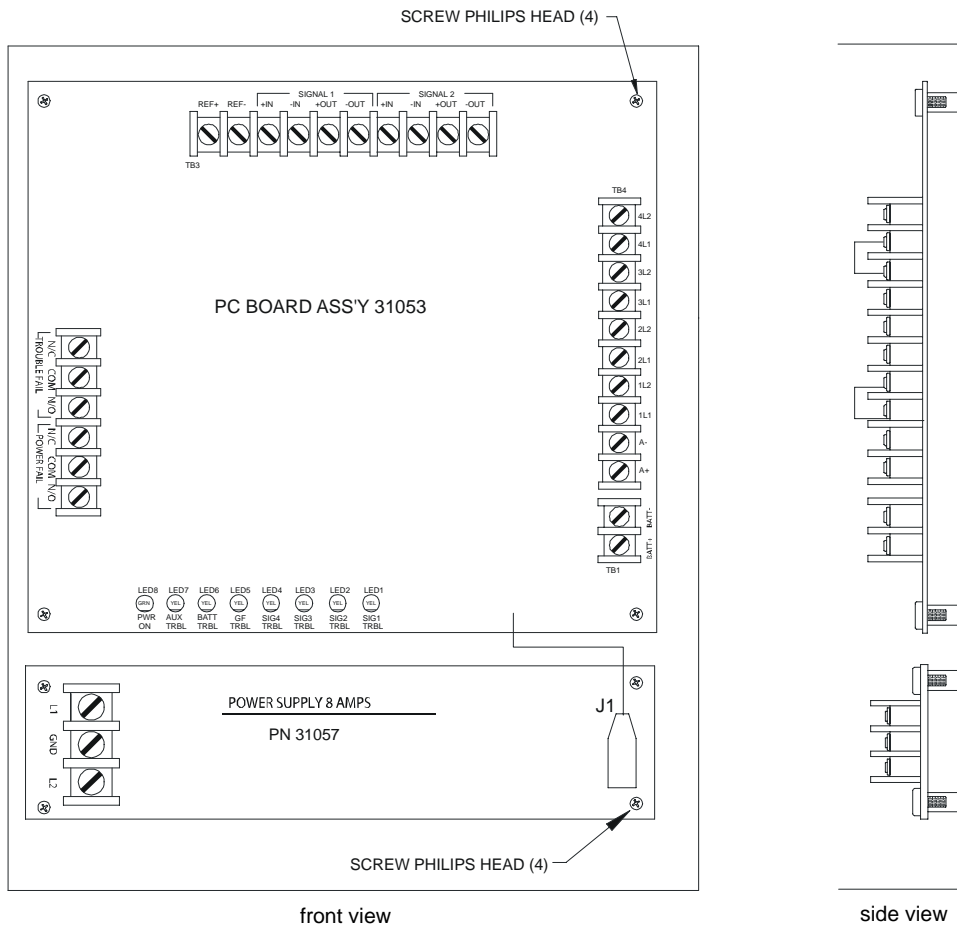


Figure 1 FireForce 8 Module Installation (A-M1236)

A-M1236gw2.wmf

Continued on next page...

